


GROUP D3 – DRAINS AND SEWERS UNDER FIELDS AND GARDENS

NOTES:  
For Notes see Drg No **SD/5/5.**

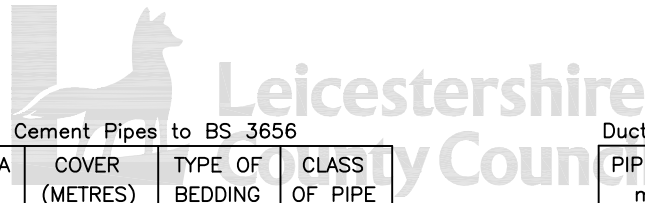

Asbestos Cement Pipes to BS 3656

| PIPE DIA<br>mm | COVER<br>(METRES) | TYPE OF<br>BEDDING | CLASS<br>OF PIPE |
|----------------|-------------------|--------------------|------------------|
| 150            | 0.6–6.0           | B                  | H                |
| 225            | 0.9–6.0           | B                  | H                |
| 300            | 0.6–4.3           | B                  | M                |
|                | 4.3–6.0           | B                  | H                |
| 375            | 0.6–4.1           | B                  | M                |
|                | 4.1–6.0           | B                  | H                |
| 450            | 0.6–3.0           | B                  | L                |
|                |                   | A                  | L                |
|                | OR B              | M                  |                  |
|                | 4.0–4.7           | A                  | L                |
|                |                   | A                  | M                |
|                | 4.7–6.0           | OR B               | H                |
| 525            |                   | 0.6–2.8            | B                |
|                | A                 |                    | L                |
|                | OR B              | M                  |                  |
|                | 4.2–5.3           | A                  | L                |
|                |                   | A                  | M                |
|                | 5.3–6.0           | OR B               | H                |
| 600            |                   | 0.6–2.4            | B                |
|                | A                 |                    | L                |
|                | OR B              | M                  |                  |
|                | 4.4–6.0           | A                  | M                |
|                |                   | OR B               | H                |

Ductile Iron to BS 4772

| PIPE DIA<br>mm | COVER<br>(METRES) | TYPE OF<br>BEDDING | CLASS<br>OF PIPE |
|----------------|-------------------|--------------------|------------------|
| 150            | 0.6–6.0           | Q                  | K9               |
| 225            | 0.6–6.0           | Q                  | K9               |
| 300            | 0.6–6.0           | Q                  | K9               |
| 450            | 0.9–6.0           | E                  | K9               |
| 600            | 1.3–6.0           | Q                  | K9               |



©Crown copyright 2007. All rights reserved. Use of this image is limited to viewing on-line and printing one copy. Leicestershire County Council. 100019271.

|   |                               |   |                                       |                |                |      |                   |  |
|---|-------------------------------|---|---------------------------------------|----------------|----------------|------|-------------------|--|
| <p>DEPARTMENT OF HIGHWAYS<br/>TRANSPORTATION AND<br/>WASTE MANAGEMENT</p> | TITLE:                        | <p align="center"><b>STANDARD DRAWING</b></p> <p align="center"><b>GROUP D3</b></p> <p align="center"><b>TABLES OF STRENGTHS AND DEPTHS</b></p> | <p align="center"><b>DRAINAGE</b></p> | DRAWING NUMBER | DATE           |      |                   |  |
|   |                               |   |                                       | SD/5/9         | SEPTEMBER 2002 |      |                   |  |
|   | AUTOCAD REF                   |   |                                       | SCALE          |                |      |                   |  |
|   | K:\GENERAL\ID9997\STDDRG\SD59 |   |                                       | NOT TO SCALE   | Rev            | Date | Notes on Revision |  |